
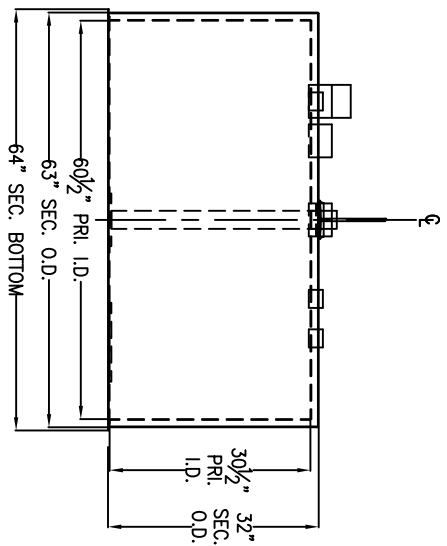


- A - 2" SCH 40 PIPE W/2" FNPT COUPLING AND 8" X 8" X 1/4" (INTERSTITIAL MONITOR / LEAK DETECTOR TUBE)
- B - 2" FNPT COUPLING (NORMAL VENT)
- C - 4" FNPT COUPLING (SUPPLY/RETURN)
- D - LIFTING LUG
- E - 4" FNPT FITTING (SECONDARY EMERGENCY VENT OPENING)
- F - 4" FNPT COUPLING (PRIMARY EMERGENCY VENT OPENING)
- G - 2" FNPT COUPLING (GAUGE STICK)
- H - 4" FNPT COUPLING (GAUGE/SPARE)
- I - 4" MNPT NIPPLE (FILL)

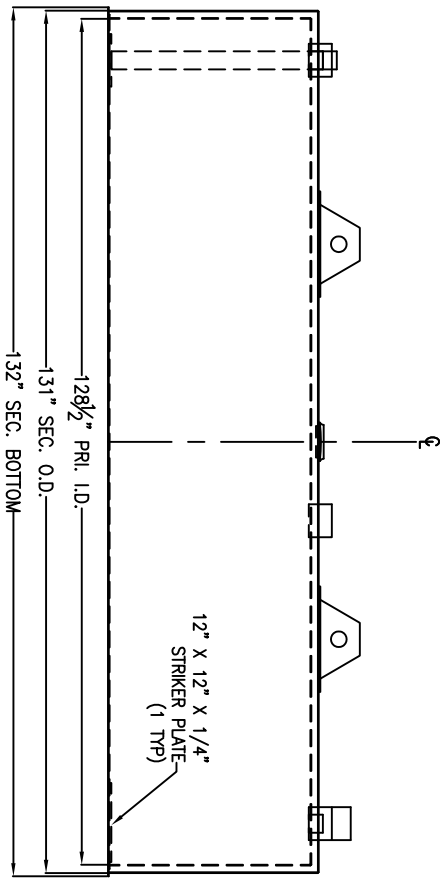

CUSTOMER APPROVAL SIGNATURE/DATE:

1,000 GALLON DW RECTANGULAR STORAGE TANK

SURFACE PREPARATION/COATING INFORMATION:

INTERIOR SURFACES: N/A
EXTERIOR SURFACES: SSPC-SP-6 COMMERCIAL BLAST
FINISH PAINT WHITE


MATERIAL /CONSTRUCTION/ LABELING INFORMATION:

MATERIAL: CARBON STEEL ASTM A 36 OR ASTM A 569
MATERIAL THICKNESS: PRIMARY TANK: 10 GA
SECONDARY TANK: 10 GA

QUANTITY: ONE (1) REQUIRED
WEIGHT: 3,250 lbs ± 10%

LABELING/MARKING: UNDERWRITERS LABORATORIES UL-142 /
SMR / SNI F-921

CUSTOMER: _____
PROJECT: _____
AGENT: _____



GENERALE INDUSTRIES
BUILDING TANKS / PROJECT
ONE INDUSTRIAL AVENUE
P.O. BOX 1279 GOLDSPRING, NC 27533
PHONE: (919) 751-1791 FAX: (919) 751-8188
DRAWING NUMBER: _____