
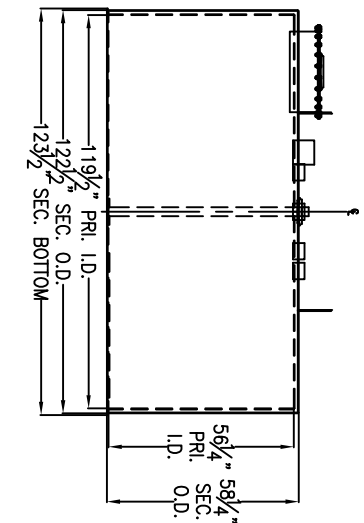


- A - 2" SCH 40 PIPE W/ 2" FNPT COUPLING AND 8" X 8" X 1/4" PLATE (INTERSTITIAL MONITOR / LEAK DETECTOR)
- B - 4" FNPT COUPLING (NORMAL VENT)
- C - 4" FNPT COUPLING (SUPPLY)
- D - 4" FNPT COUPLING (RETURN)
- E - 24" STANDARD MANWAY W/ 8" FNPT FITTING (PRIMARY EMERGENCY VENT OPENING)
- F - 8" FNPT FITTING (SECONDARY EMERGENCY VENT OPENING)
- G - 4" FNPT COUPLING (GAUGE STICK)
- H - 4" FNPT COUPLING (GAUGE/SPARE)
- I - 6" MNPT NIPPLE (FILL)
- J - 4" FNPT COUPLING (PROBE)
- K - LIFT LUG

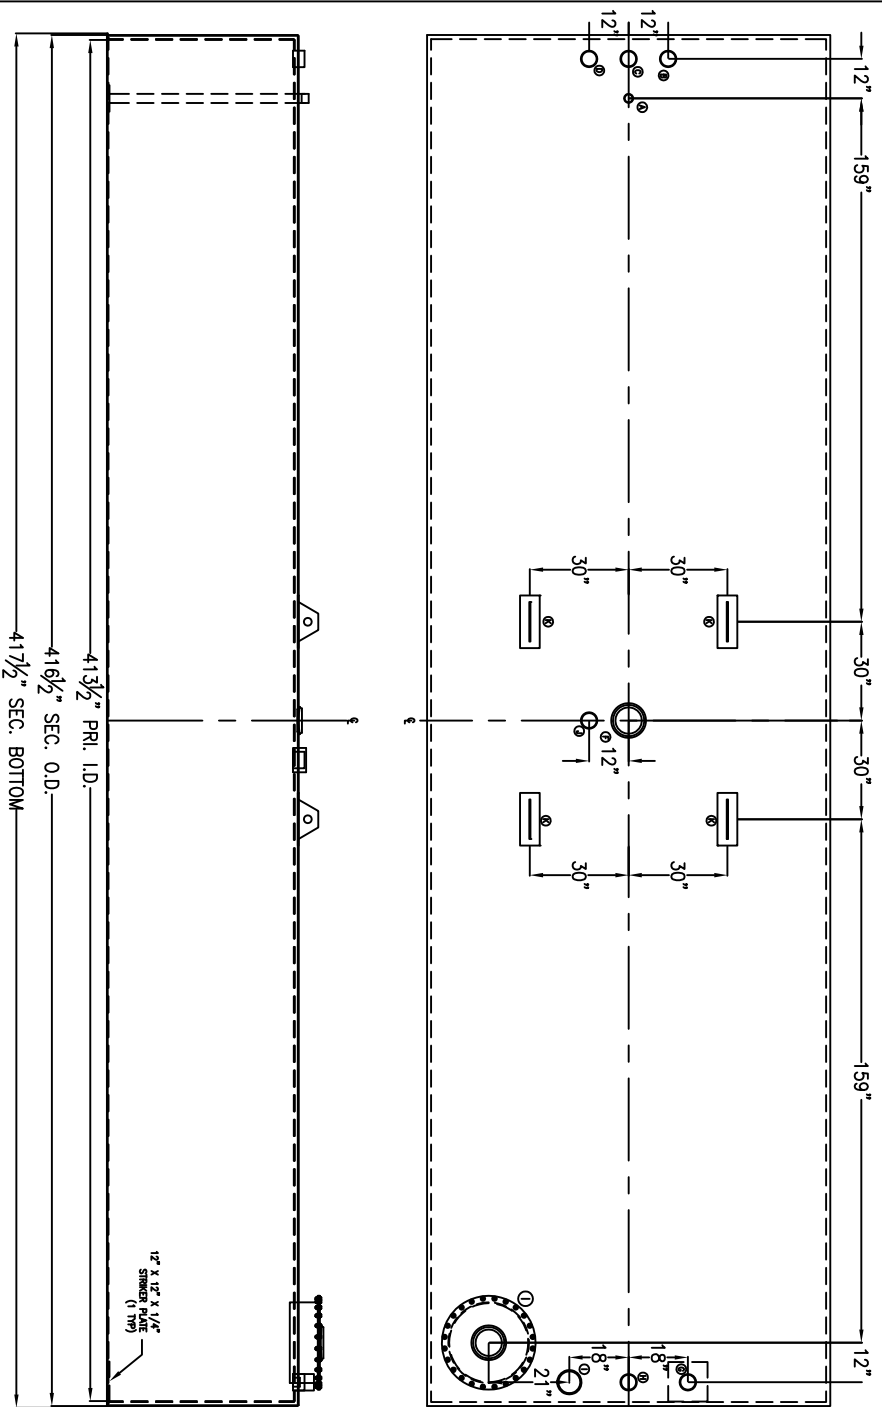

CUSTOMER APPROVAL SIGNATURE/DATE:

12,000 GALLON DW RECTANGULAR STORAGE TANK

SURFACE PREPARATION/COATING INFORMATION:

INTERIOR SURFACES: N/A
EXTERIOR SURFACES: SSPC-SP-6 COMMERCIAL BLAST
FINISH PAINT WHITE


MATERIAL /CONSTRUCTION/ LABELING INFORMATION:

MATERIAL: CARBON STEEL ASTM A 36 OR ASTM A 569
MATERIAL THICKNESS: PRIMARY TANK: 1/4"
SECONDARY TANK: 1/4"

QUANTITY: ONE (1) REQUIRED
WEIGHT: 24,000 lbs ± 10%

LABELING/MARKING: UNDERWRITERS LABORATORIES UL-142 / SMR / SNI F-921

CUSTOMER: _____
PROJECT: _____
AGENT: _____



GENERAL INDUSTRIES
BUILDING TANKS / PROJECT
ONE TANKS / PROJECT

P.O. BOX 1279 GOLDSPORO, NC 27533
PHONE: (919) 751-1791 FAX: (919) 751-8188
DRAWING NUMBER: _____