
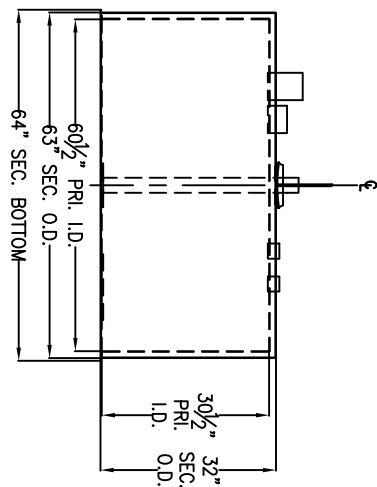
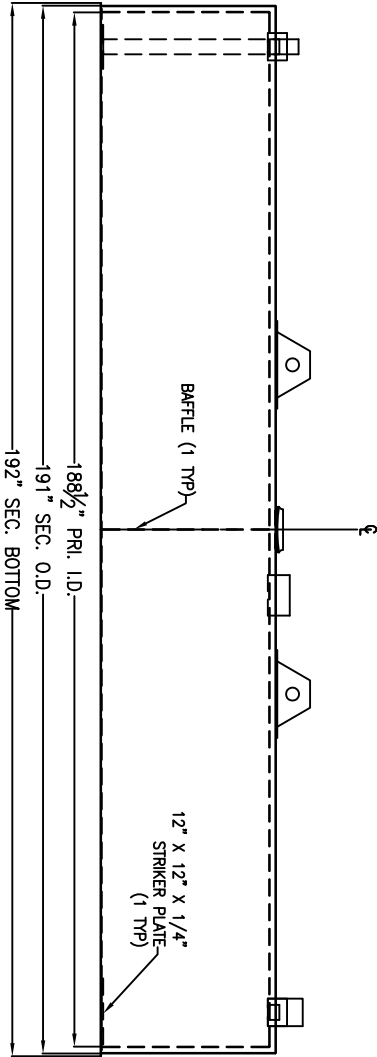


- A - 2" SCH 40 PIPE W/ 2" FNPT COUPLING AND 8" X 8" X 1/4" PLATE (INTERSTITIAL MONITOR / LEAK DETECTOR)
- B - 2" FNPT COUPLING (NORMAL VENT)
- C - 4" FNPT COUPLING (SUPPLY/RETURN)
- D - LIFTING LUG
- E - 6" FNPT COUPLING (SECONDARY EMERGENCY VENT OPENING)
- F - 6" FNPT FITTING (PRIMARY EMERGENCY VENT OPENING)
- G - 2" FNPT COUPLING (GAUGE STICK)
- H - 4" FNPT COUPLING (GAUGE/SPARE)
- I - 4" MNPT NIPPLE (FILL)

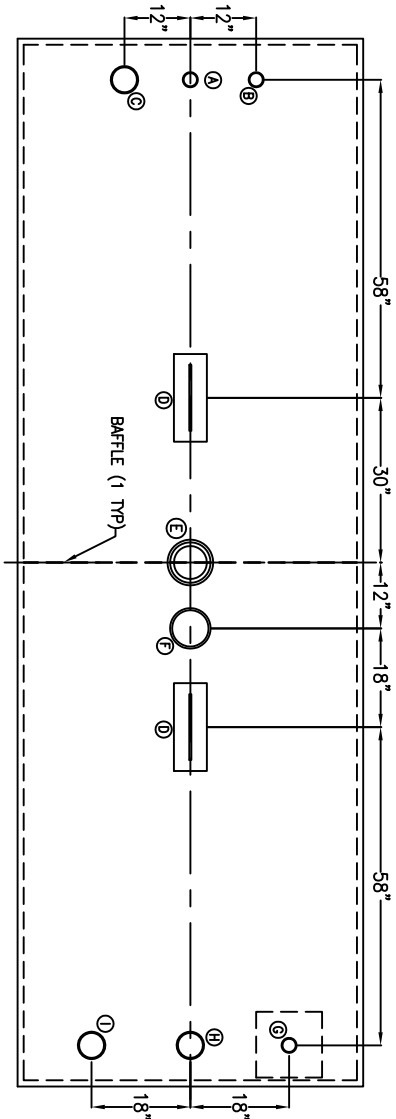

CUSTOMER APPROVAL SIGNATURE/DATE:

1,500 GALLON DW FLAMESHIELD RECTANGULAR STORAGE TANK

SURFACE PREPARATION/COATING INFORMATION:

INTERIOR SURFACES: N/A
 EXTERIOR SURFACES: SSPC-SP-6 COMMERCIAL BLAST
 FINISH PAINT WHITE

MATERIAL /CONSTRUCTION/ LABELING INFORMATION:

MATERIAL: CARBON STEEL ASTM A 36 OR ASTM A 569
 MATERIAL THICKNESS: PRIMARY TANK: 10 GA
 SECONDARY TANK: 10 GA

QUANTITY: ONE (1) REQUIRED
 WEIGHT: 4,500 lbs ± 10%

LABELING/MARKING: UNDERWRITERS LABORATORIES UL-142 / STI FLAMESHIELD

CUSTOMER: _____ PROJECT: _____
 AGENT: _____

GENERAL INDUSTRIES
 BUILDING TANKS DIVISION
 OIL TANKS PROJECT

P.O. BOX 1279 GOLDSBORO, NC 27533
 PHONE: (919) 751-1791 FAX: (919) 751-8188
 DRAWING NUMBER: _____