Underwriters Laboratories Inc.
LISTED ®

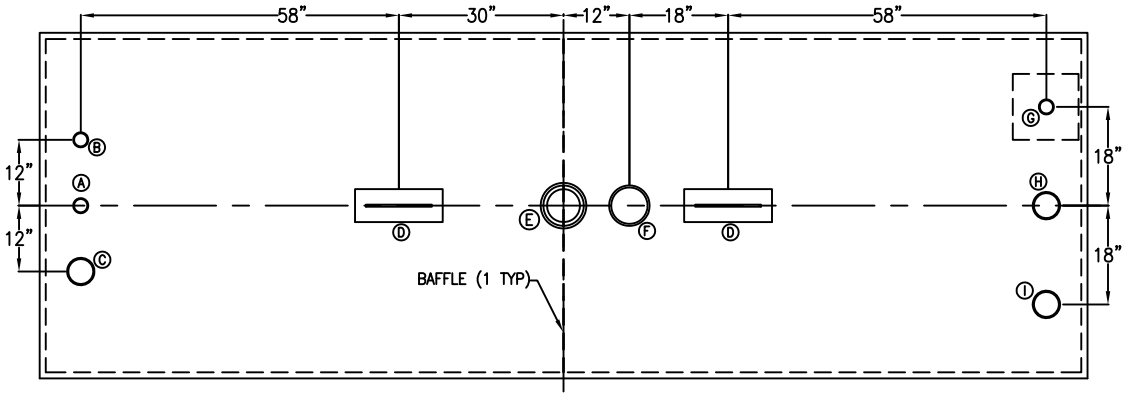

A – 2" SCH 40 PIPE W/ 2" FNPT COUPLING AND 8" X 8" X 1/4" PLATE (INTERSTITIAL MONITOR / LEAK DETECTOR)
B – 2" FNPT COUPLING (NORMAL VENT)
C – 4" FNPT COUPLING (SUPPLY/RETURN)
D – LIFTING LUG
E – 6" FNPT COUPLING (SECONDARY EMERGENCY VENT OPENING)
F – 6" FNPT FITTING (PRIMARY EMERGENCY VENT OPENING)
G – 2" FNPT COUPLING (GAUGE STICK)
H – 4" FNPT COUPLING (GAUGE/SPARE)
I – 4" MNPT NIPPLE (FILL)

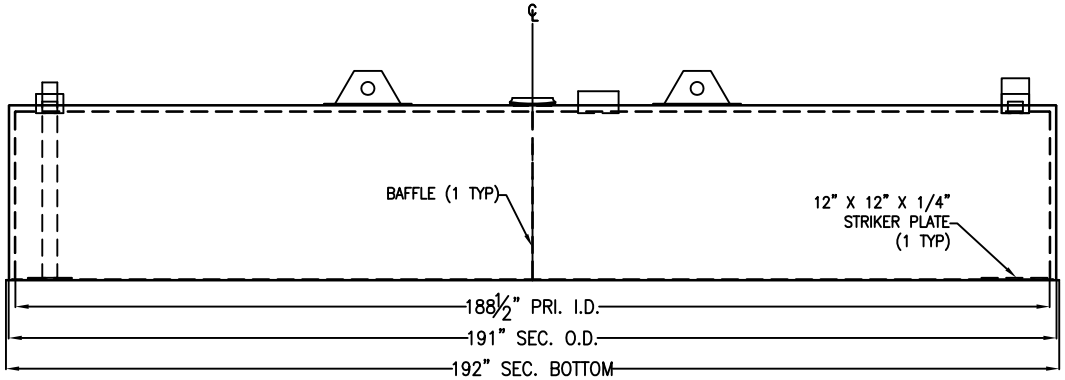

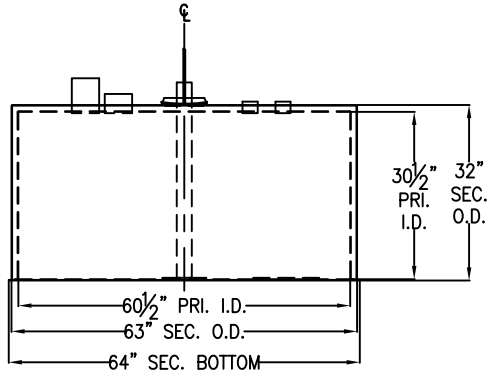

CUSTOMER APPROVAL SIGNATURE/DATE:

QUANTITY: ONE (1) REQUIRED
WEIGHT: 3,500 lbs ± 10%

1,500 GALLON DW RECTANGULAR STORAGE TANK

SURFACE PREPARATION/COATING INFORMATION:

INTERIOR SURFACES: N/A

EXTERIOR SURFACES: SSPC-SP-6 COMMERCIAL BLAST
FINISH PAINT WHITE

MATERIAL /CONSTRUCTION/ LABELING INFORMATION:

MATERIAL: CARBON STEEL ASTM A 36 OR ASTM A 569

MATERIAL THICKNESS: PRIMARY TANK: 10 GA
SECONDARY TANK: 10 GA

LABELING/MARKING: UNDERWRITERS LABORATORIES UL-142 / SWRI / STI F-921

CUSTOMER:
PROJECT:
AGENT:

GENERAL INDUSTRIES
BUILDING TANKS TO PROTECT OUR ENVIRONMENT
P.O. BOX 1279 GOLDSBORO, NC 27533
PHONE: (919)751-1791 FAX: (919)751-8186

DRAWING NUMBER: