
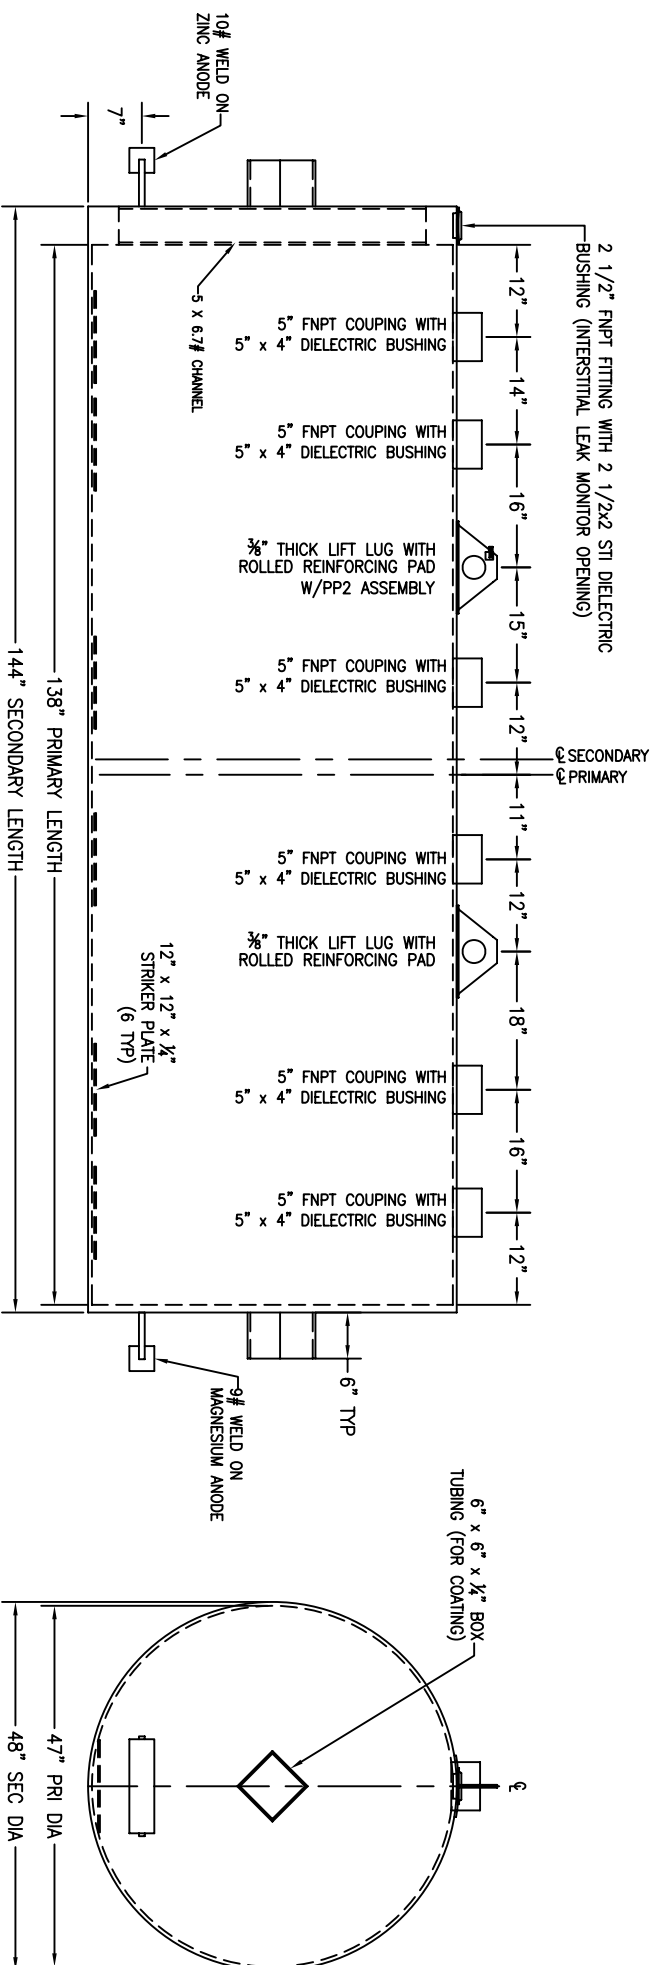


ALL OPENINGS INSTALLED WITH DI-ELECTRIC BUSHINGS OR SPOOL FLANGES AND FLANGE ISOLATION KITS IN ACCORDANCE WITH STEEL TANK INSTITUTE 1/4" THICK STRIKER PLATES INSTALLED ON THE TANK INTERIOR BOTTOM UNDER EACH OPENING IN ACCORDANCE WITH STEEL TANK INSTITUTE ANODES FOR USE WITH THE STI-P3 CORROSION CONTROL SYSTEM INSTALLED IN ACCORDANCE WITH STEEL TANK INSTITUTE \*\*\* THIS TANK DESIGNED FOR BURIAL DEPTH OF 16 FEET (GRADE TO TOP OF TANK) WITH APPROVED BACKFILL MATERIAL \*\*\*

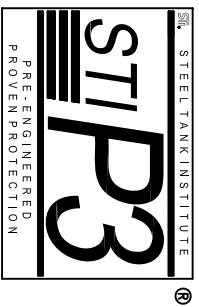

CUSTOMER APPROVAL SIGNATURE/DATE:

1,000 GALLON STI-P3 DW UNDER GROUND TANK

SURFACE PREPARATION/COATING INFORMATION:

MATERIAL /CONSTRUCTION/ LABELING INFORMATION:

INTERIOR SURFACES:  
N/A

MATERIAL: CARBON STEEL (ASTM A 36, ASTM A 635 OR ASTM A 569)  
MATERIAL THICKNESS: PRIMARY TANK: 10 GA (ROARK MINIMUM 123) PRIMARY HEADS: 10 GA  
SECONDARY SHELL: 10 GA SECONDARY HEAD: 10 GA

EXTERIOR SURFACES:  
SSPC-SP-6 COMMERCIAL BLAST CLEAN  
10-15 mils MINIMUM STI APPROVED POLYURETHANE COATING

CONSTRUCTION IN ACCORDANCE WITH UNDERWRITERS LABORATORIES UL-58 STANDARD FOR STEEL UNDERGROUND TANKS FOR FLAMMABLE AND COMBUSTIBLE LIQUIDS AND STEEL TANK INSTITUTE STI-P3 SPECIFICATION FOR EXTERNAL CORROSION PROTECTION OF UNDERGROUND STEEL STORAGE TANKS  
LABELING/MARKING: UNDERWRITERS LABORATORIES UL-58 / STEEL TANK INSTITUTE STI-P3 / GENERAL INDUSTRIES NAMEPLATE

QUANTITY: ONE (1) REQUIRED  
WEIGHT: 3,500 lbs ± 5%

CUSTOMER: \_\_\_\_\_  
PROJECT: \_\_\_\_\_  
AGENT: \_\_\_\_\_

GENERAL INDUSTRIES  
BUILT FOR TANKS TO PERFORM  
ON THE FRONT LINE

P.O. BOX 1279    GOLDSBORO, NC 27533  
PHONE: (919)751-1791    FAX: (919)751-8185  
DRAWING NUMBER: \_\_\_\_\_