



ALL OPENINGS INSTALLED WITH DI-ELECTRIC BUSHINGS OR SPOOL FLANGES AND FLANGE ISOLATION KITS IN ACCORDANCE WITH STEEL TANK INSTITUTE 1/4" THICK STRIKER PLATES INSTALLED ON THE TANK INTERIOR BOTTOM UNDER EACH OPENING IN ACCORDANCE WITH STEEL TANK INSTITUTE ANODES FOR USE WITH THE STI-P3 CORROSION CONTROL SYSTEM INSTALLED IN ACCORDANCE WITH STEEL TANK INSTITUTE *** THIS TANK DESIGNED FOR BURIAL DEPTH OF 16 FEET (GRADE TO TOP OF TANK) WITH APPROVED BACKFILL MATERIAL ***

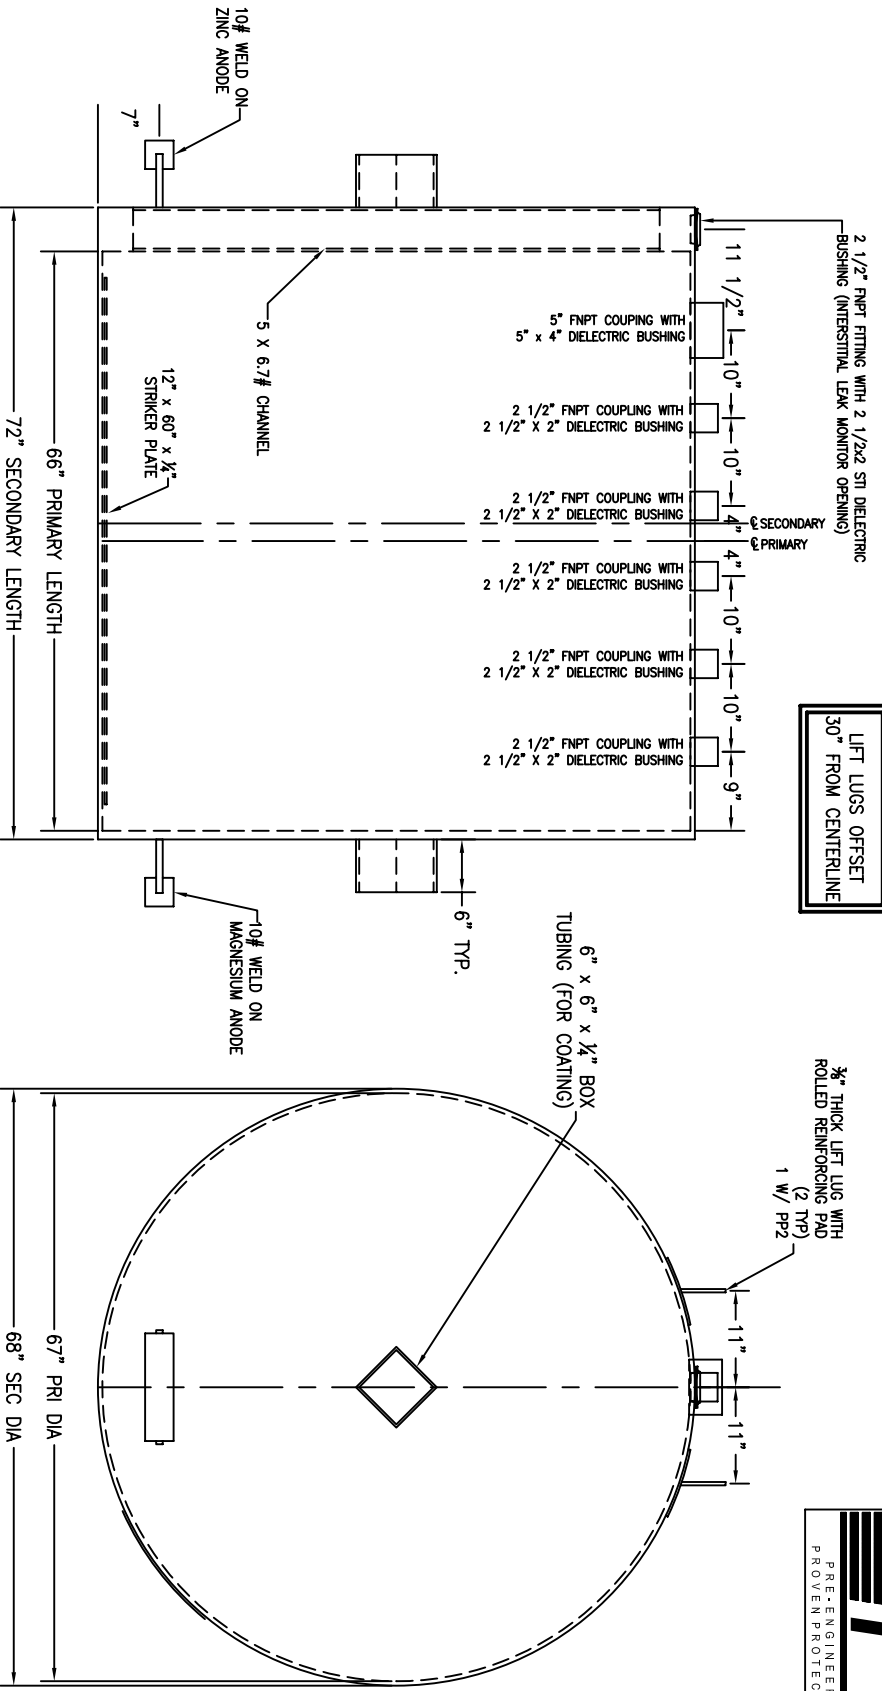

LIFT LUGS OFFSET
30" FROM CENTERLINE

3/8" THICK LIFT LUG WITH
ROLLED REINFORCING PAD
(2 TYP)
1 W/ PP2



CUSTOMER APPROVAL SIGNATURE/DATE:

1,000 GALLON STI=P3 DW UNDER GROUND TANK

SURFACE PREPARATION/COATING INFORMATION:

INTERIOR SURFACES:
N/A

EXTERIOR SURFACES:
SSPC-SP-6 COMMERCIAL BLAST CLEAN
10-15 MILS MINIMUM STI APPROVED POLYURETHANE COATING

MATERIAL /CONSTRUCTION/ LABELING INFORMATION:

MATERIAL: CARBON STEEL (ASTM A 36, ASTM A 635 OR ASTM A 569)
MATERIAL THICKNESS: PRIMARY TANK: 10 GA (ROARK MINIMUM .123) PRIMARY HEADS: 10 GA
SECONDARY SHELL: 10 GA SECONDARY HEAD: 7 GA
CONSTRUCTION IN ACCORDANCE WITH UNDERWRITERS LABORATORIES UL-58 STANDARD FOR
STEEL UNDERGROUND TANKS FOR FLAMMABLE AND COMBUSTIBLE LIQUIDS AND STEEL TANK
INSTITUTE STI-P3 SPECIFICATION FOR EXTERNAL CORROSION PROTECTION OF UNDERGROUND
STEEL STORAGE TANKS
LABELING/MARKING: UNDERWRITERS LABORATORIES UL-58 / STEEL TANK INSTITUTE STI-P3 /
GENERAL INDUSTRIES NAMEPLATE

QUANTITY: ONE (1) REQUIRED
WEIGHT: 3,250 lbs ± 5%

CUSTOMER: _____
PROJECT: _____
AGENT: _____

GENERAL INDUSTRIES
BUILDING TANKS PROJECT
OIL TANKS PROJECT
P.O. BOX 1279 60105B060, NC 27533
PHONE: (919)751-1791 FAX: (919)751-8185
DRAWING NUMBER: _____