


9/16" HOLES FOR MOUNTING (20 TYP)
INTERNAL STUB UP LOCATED AS REQUIRED

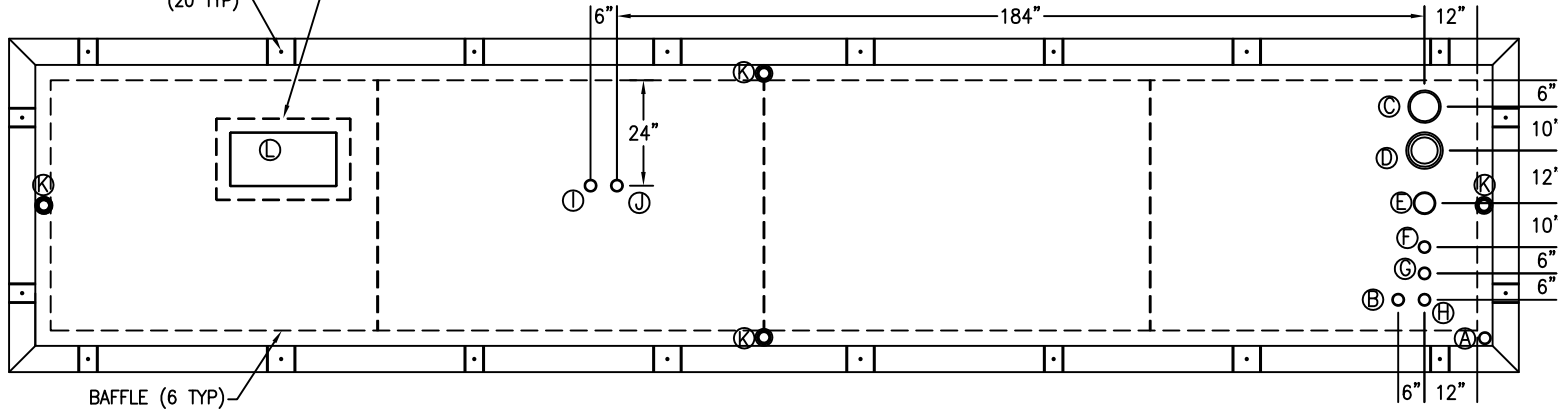


- A - 2" FNPT COUPLING W/ 2" PIPE (INTERSTIAL MONITOR)
 - B - 2" FNPT F/G COUPLING (NORMAL VENT)
 - C - 6" FNPT F/G COUPLING (PRI. E-VENT)
 - D - 6" FNPT FITTING (SEC. E-VENT)
 - E - 4" MNPT NIPPLE (FILL)
 - F - 2" FNPT F/G COUPLING (GAUGE)
 - G - 2" FNPT F/G COUPLING (PROBE)
 - H - 2" FNPT F/G COUPLING (SPARE)
 - I - 2" FNPT F/G COUPLING (SUPPLY)
 - J - 2" FNPT F/G COUPLING (RETURN)
 - K - 2" FNPT FITTING (FIREGUARD MIX FILL)
 - L - 24" X 12" INTERNAL STUB UP
- *** BEAMS CAN BE PROVIDED AS REQUIRED

BAFFLE (6 TYP)

VERTICAL SUPPORTS

LIFT LUG (8 TYP) FOR TANK LIFT ONLY

6" X 8.2# RIM CHANNEL

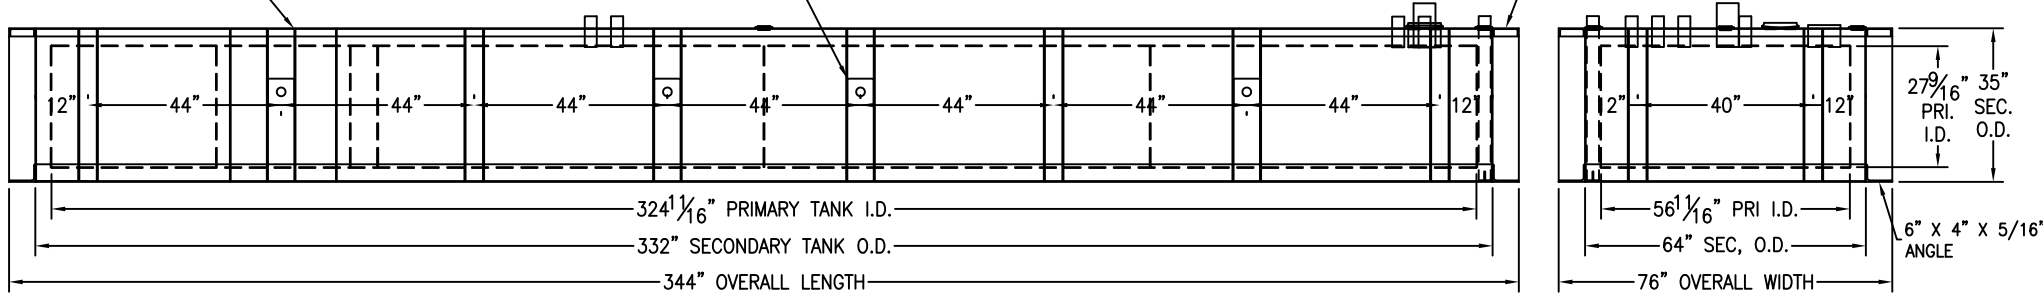

CUSTOMER APPROVAL SIGNATURE/DATE:

2,130 GAL (1,695 USEABLE) GENBASE THERMALLY INSULATED STORAGE TANK

CUSTOMER:

SURFACE PREPARATION/COATING INFORMATION:

MATERIAL /CONSTRUCTION/ LABELING INFORMATION:

PROJECT:

INTERIOR SURFACES:
N/A

MATERIAL: CARBON STEEL ASTM A 36 OR ASTM A 569
MATERIAL THICKNESS: PRIMARY SHELL 7 GA
SECONDARY SIDE 7 GA



EXTERIOR SURFACES:
SSPC-SP-6 COMMERCIAL BLAST CLEAN
ONE COAT DEVOE 205 EPOXY PRIMER @ 4mils DFT
ONE COAT DEVOE 359 WHITE URETHANE @ 6mils DFT
COAL TAR EPOXY ON EXTERIOR BOTTOM

CONSTRUCTION IN ACCORDANCE WITH UNDERWRITERS LABORATORIES UL-2085 STANDARD FOR STEEL ABOVEGROUND STORAGE TANKS FOR FLAMMABLE AND COMBUSTIBLE LIQUIDS AND STEEL TANK INSTITUTE STANDARD F941 FIREGUARD THERMALLY INSULATED ABOVEGROUND STORAGE TANK
LABELING/MARKING: UNDERWRITERS LABORATORIES UL-2085

AGENT:
P.O. BOX 1279 GOLDSBORO, NC 27533
PHONE: (919)751-1791 FAX: (919)751-8186
DRAWING NUMBER: GIPGB2130
REVISED 10/08

QUANTITY: ONE (1) REQUIRED
WEIGHT: 15,500 lb ± 10%