



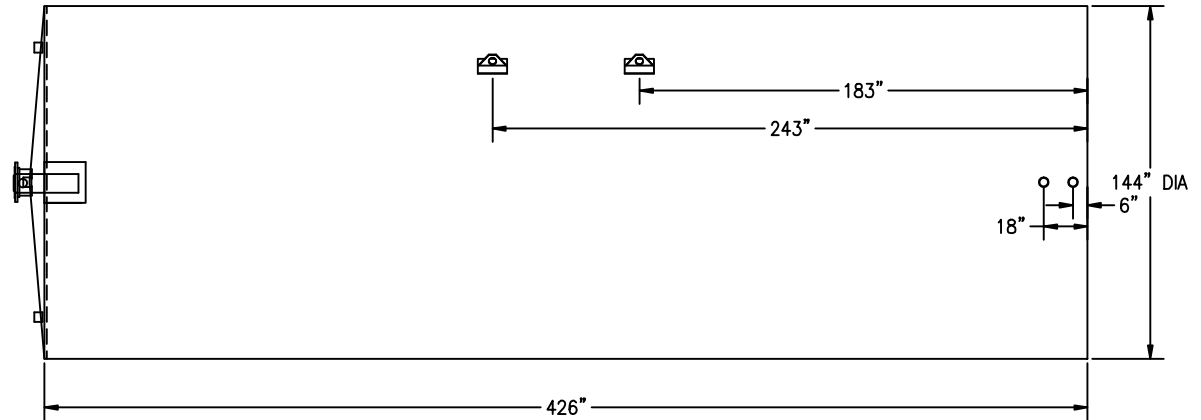

ANGLE:	LOCATION:	DESCRIPTION:	ANGLE:	LOCATION:	DESCRIPTION:
0°	SHELL, DOWN 8 1/2"	1/2" THICK ERECTION LUG w/ ROLLED REPAD	120°	SHELL, UP 183"	3/8" THICK LIFT LUG w/ ROLLED REPAD
0°	SHELL, UP 6"	3" COUPLING	120°	SHELL, UP 243"	3/8" THICK LIFT LUG w/ ROLLED REPAD
0°	SHELL, UP 18"	3" COUPLING	180°	SHELL, UP 2"	1" COUPLING
0°	TOP, 55" RADIUS	10" 150# RFSO FLANGE (EMERGENCY VENT)	180°	SHELL, DOWN 8 1/2"	1/2" THICK ERECTION LUG w/ ROLLED REPAD
90°	SHELL, UP 183"	3/8" THICK LIFT LUG w/ ROLLED REPAD	180°	TOP, 55" RADIUS	3" COUPLING
90°	SHELL, UP 243"	3/8" THICK LIFT LUG w/ ROLLED REPAD	270°	TOP, 55" RADIUS	3" COUPLING
90°	TOP, 55" RADIUS	3" COUPLING	N/A	TOP, CENTER	2" COUPLING (NORMAL VENT)

STANDARD LAP/OFFSET WELD CONSTRUCTION TO UL-142 STANDARDS AND SPECIFICATIONS
 ALL BOLT HOLES TO STRADDLE MAJOR CENTERLINES OR THEIR PARALLELS

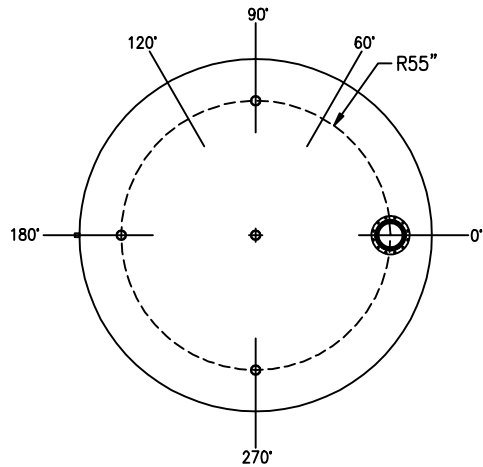

CUSTOMER APPROVAL SIGNATURE/DATE:

29,600 GALLON VERTICAL SW ABOVE GROUND TANK

SURFACE PREPARATION/COATING INFORMATION:

INTERIOR SURFACES:
 N/A

EXTERIOR SURFACES:
 SSPC-SP-6 COMMERCIAL BLAST CLEAN
 ONE COAT PRIMER
 BLACK ASPHALTUM PAINT ON EXTERIOR BOTTOM

MATERIAL /CONSTRUCTION/ LABELING INFORMATION:

MATERIAL: CARBON STEEL (ASTM A 36, ASTM A 635 OR ASTM A 569)
 MATERIAL THICKNESS: PRIMARY TANK: TOP: 7 GA SHELL: 1/4" BOTTOM: 1/4"

CONSTRUCTION IN ACCORDANCE WITH UNDERWRITERS LABORATORIES UL-142 STANDARDS FOR STEEL ABOVEGROUND TANKS FOR FLAMMABLE AND COMBUSTIBLE LIQUIDS

LABELING/MARKING: UNDERWRITERS LABORATORIES UL-142 / GENERAL INDUSTRIES NAMEPLATE

QUANTITY: ONE (1) REQUIRED
 WEIGHT: 16,150 lbs ± 5%

CUSTOMER:

PROJECT:

AGENT: