


ALL OPENINGS INSTALLED WITH DI-ELECTRIC BUSHINGS OR SPOOL FLANGES AND FLANGE ISOLATION KITS IN ACCORDANCE WITH STEEL TANK INSTITUTE 1/4" THICK STRIKER PLATES INSTALLED ON THE TANK INTERIOR BOTTOM UNDER EACH OPENING IN ACCORDANCE WITH STEEL TANK INSTITUTE ANODES FOR USE WITH THE STI-P3 CORROSION CONTROL SYSTEM INSTALLED IN ACCORDANCE WITH STEEL TANK INSTITUTE \*\*\* THIS TANK DESIGNED FOR BURIAL DEPTH OF 16 FEET (GRADE TO TOP OF TANK) WITH APPROVED BACKFILL MATERIAL \*\*\*

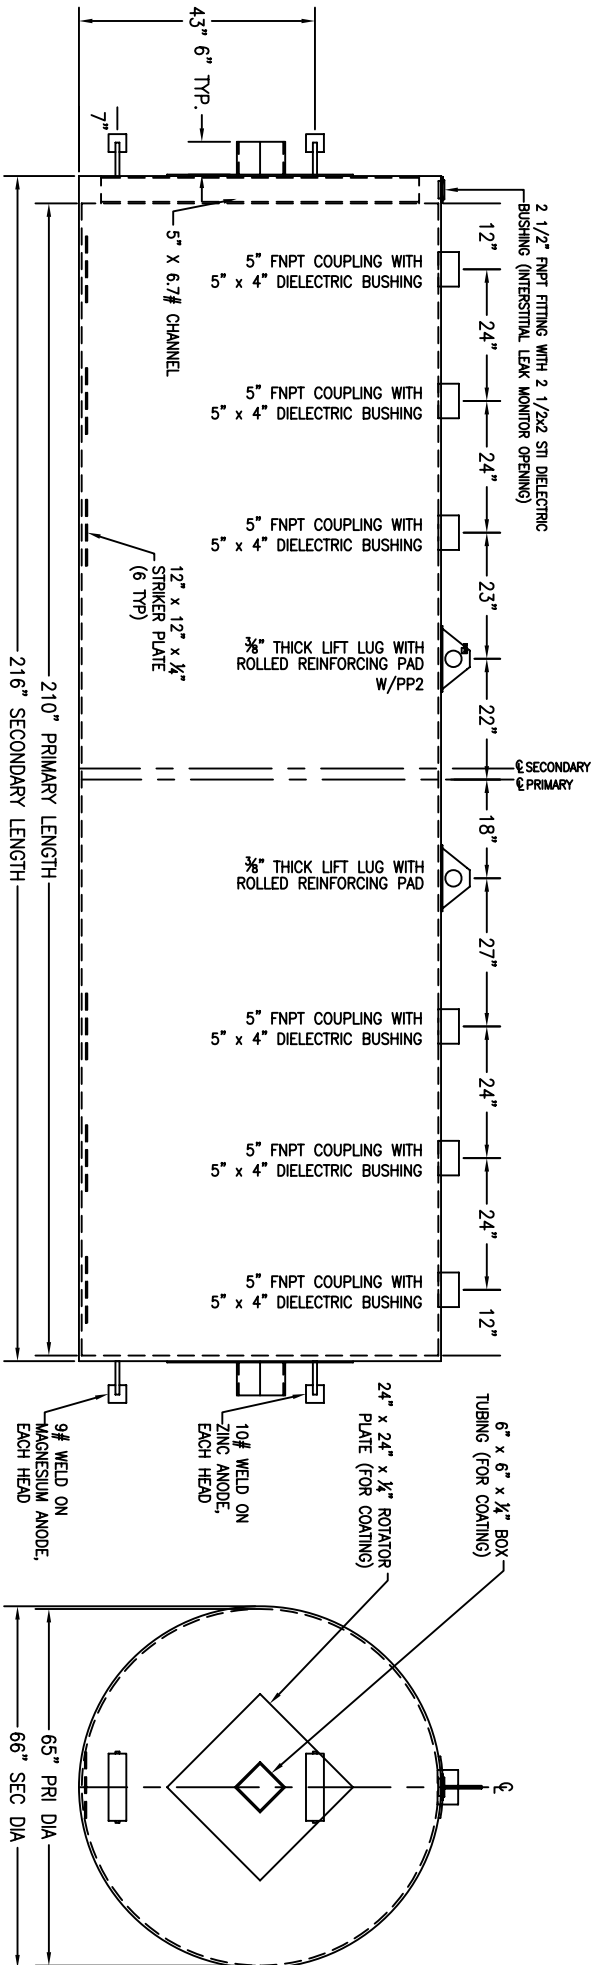

CUSTOMER APPROVAL SIGNATURE/DATE:

3,000 GALLON STI-P3 DW UNDER GROUND TANK

SURFACE PREPARATION/COATING INFORMATION:

MATERIAL /CONSTRUCTION/ LABELING INFORMATION:

QUANTITY: ONE (1) REQUIRED  
WEIGHT: 5,750 lbs ± 5%

INTERIOR SURFACES: N/A  
EXTERIOR SURFACES: SSPC-SP-6 COMMERCIAL BLAST CLEAN  
10-15 mils MINIMUM STI APPROVED POLYURETHANE COATING

MATERIAL: CARBON STEEL (ASTM A 36, ASTM A 635 OR ASTM A 569)  
MATERIAL THICKNESS: PRI TANK: 10 GA. (ROARK MIN. 123) PRI HEADS: 10 GA  
SECONDARY SHELL: 10 GA. SECONDARY HEAD: 7 GA  
CONSTRUCTION IN ACCORDANCE WITH UNDERWRITERS LABORATORIES UL-58 STANDARD FOR STEEL UNDERGROUND TANKS FOR FLAMMABLE AND COMBUSTIBLE LIQUIDS AND STEEL TANK INSTITUTE STI-P3 SPECIFICATION FOR EXTERNAL CORROSION PROTECTION OF UNDERGROUND STEEL STORAGE TANKS  
LABELING/MARKING: UNDERWRITERS LABORATORIES UL-58 / STEEL TANK INSTITUTE STI-P3 / GENERAL INDUSTRIES NAMEPLATE

CUSTOMER: \_\_\_\_\_ PROJECT: \_\_\_\_\_ AGENT: \_\_\_\_\_

**GENERAL INDUSTRIES**  
BULLDOZER TANKS DIVISION  
CORROSION CONTROL DEPARTMENT  
P.O. BOX 1279 GOLSBORO, NC 27533  
PHONE: (919)751-1791 FAX: (919)751-8185  
DRAWING NUMBER: \_\_\_\_\_

