

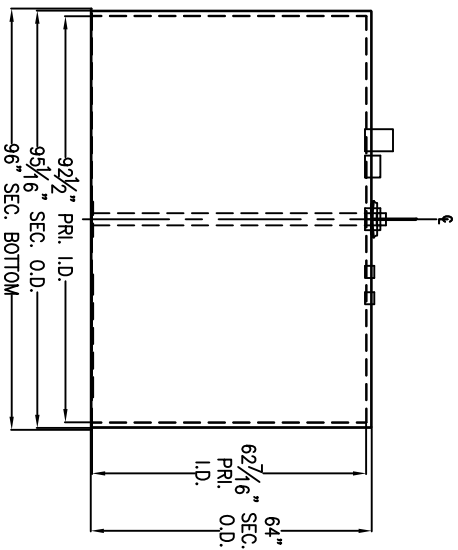


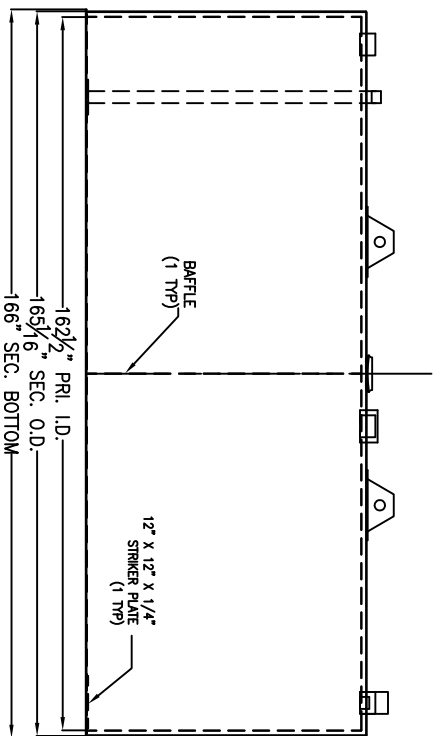

- A - 2" SCH 40 PIPE W/ 2" FNPT COUPLING AND 8" X 8" X 1/4" PLATE (INTERSTITIAL MONITOR / LEAK DETECTOR)
- B - 4" FNPT COUPLING (NORMAL VENT)
- C - 4" FNPT COUPLING (SUPPLY)
- D - 4" FNPT COUPLING (RETURN)
- E - 6" FNPT COUPLING (SECONDARY EMERGENCY VENT OPENING)
- F - 6" FNPT FITTING (PRIMARY EMERGENCY VENT OPENING)
- G - 4" FNPT COUPLING (GAUGE STICK)
- H - 4" FNPT COUPLING (GAUGE/SPARE)
- I - 4" MNPT NIPPLE (FILL)
- J - 4" FNPT COUPLING (PROBE)
- K - LIFT LUG

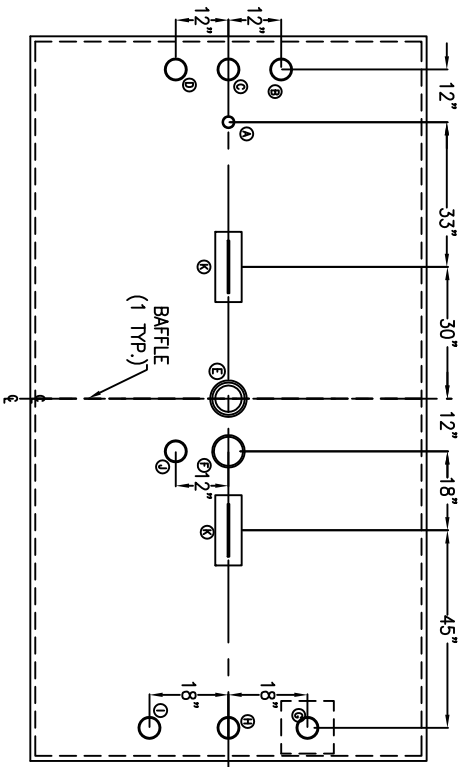

CUSTOMER APPROVAL SIGNATURE/DATE:

4,000 GALLON DW RECTANGULAR STORAGE TANK

**SURFACE PREPARATION/COATING INFORMATION:**

INTERIOR SURFACES: N/A  
 EXTERIOR SURFACES: SSPC-SP-6 COMMERCIAL BLAST  
 FINISH PAINT WHITE

**MATERIAL /CONSTRUCTION/ LABELING INFORMATION:**

MATERIAL: CARBON STEEL ASTM A 36 OR ASTM A 569  
 MATERIAL THICKNESS: PRIMARY TANK: 10 GA  
 SECONDARY TANK: 7 GA

QUANTITY: ONE (1) REQUIRED  
 WEIGHT: 7,000 lbs ± 10%

LABELING/MARKING: UNDERWRITERS LABORATORIES UL-142 /  
 SMR / SRI F-921

CUSTOMER: \_\_\_\_\_  
 PROJECT: \_\_\_\_\_  
 AGENT: \_\_\_\_\_

GENERAL INDUSTRIES  
 BUILDING TANKS / PROJECT  
 OIL TANKS / VENT

P.O. BOX 1279 GOLDSPRING, NC 27533  
 TEL: (919) 751-1791 FAX: (919) 751-8188  
 DRAWING NUMBER: \_\_\_\_\_