
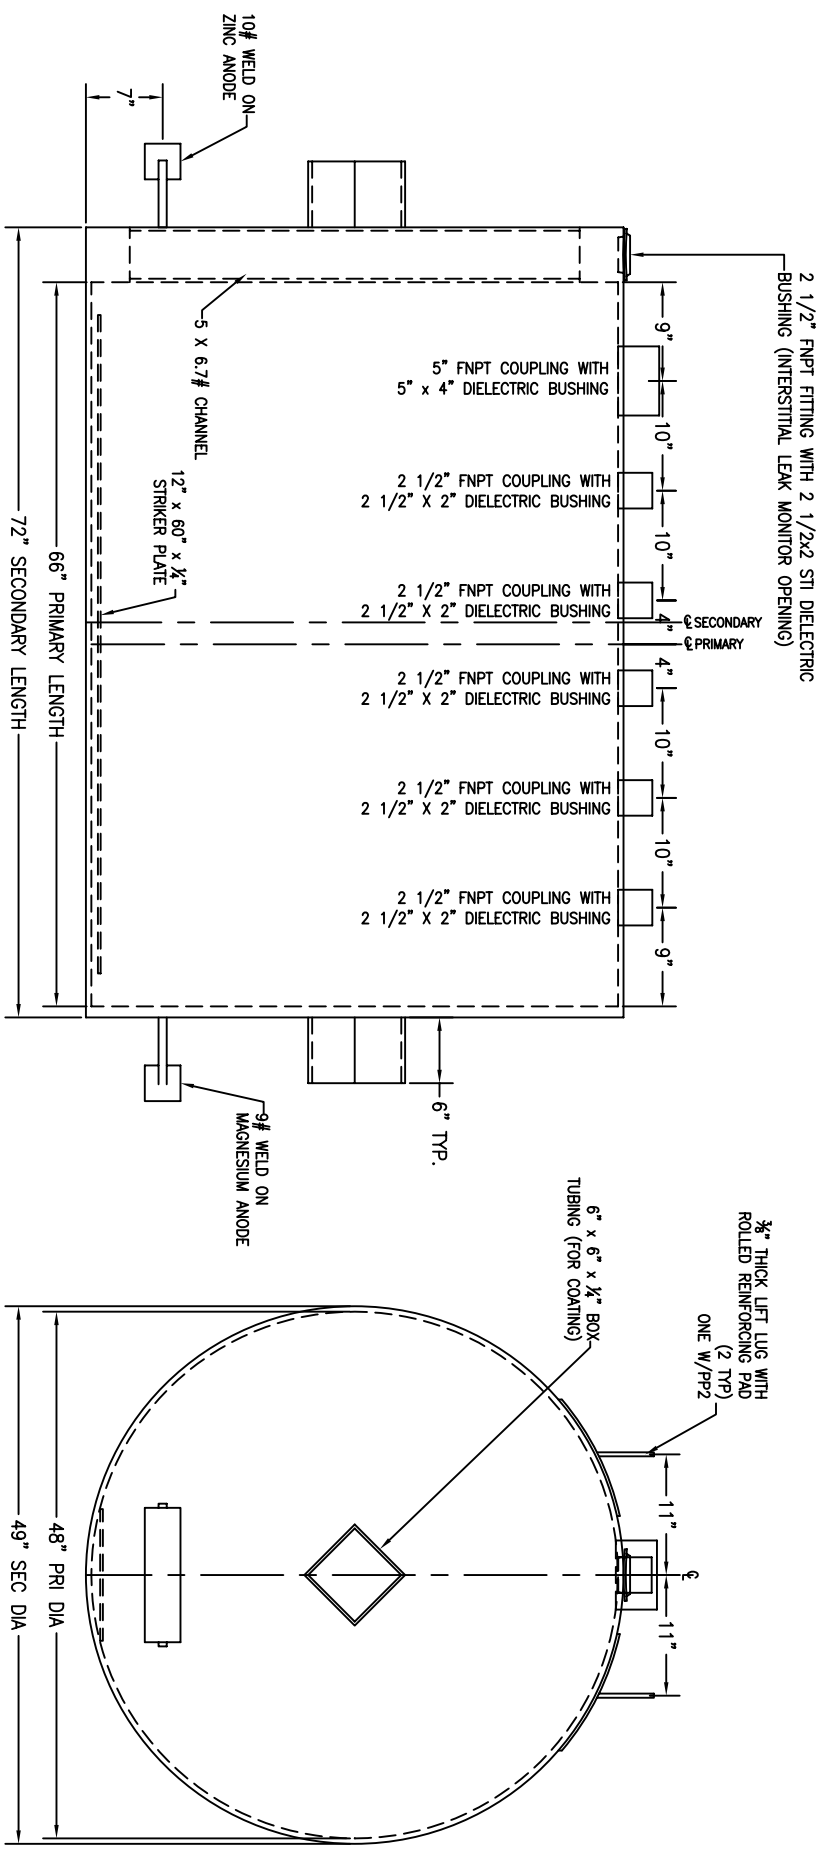


ALL OPENINGS INSTALLED WITH DI-ELECTRIC BUSHINGS OR SPOOL FLANGES AND FLANGE ISOLATION KITS IN ACCORDANCE WITH STEEL TANK INSTITUTE 1/4" THICK STRIKER PLATES INSTALLED ON THE TANK INTERIOR BOTTOM UNDER EACH OPENING IN ACCORDANCE WITH STEEL TANK INSTITUTE ANODES FOR USE WITH THE STI-P3 CORROSION CONTROL SYSTEM INSTALLED IN ACCORDANCE WITH STEEL TANK INSTITUTE *** THIS TANK DESIGNED FOR BURIAL DEPTH OF 16 FEET (GRADE TO TOP OF TANK) WITH APPROVED BACKFILL MATERIAL ***

LIFT LUGS OFFSET
30" FROM CENTERLINE



CUSTOMER APPROVAL SIGNATURE/DATE:

500 GALLON STI-P3 S/W UNDER GROUND TANK

SURFACE PREPARATION/COATING INFORMATION:

INTERIOR SURFACES:
N/A

EXTERIOR SURFACES:
SSPC-SP-6 COMMERCIAL BLAST CLEAN
10-15 MILS MINIMUM STI APPROVED POLYURETHANE COATING

QUANTITY: ONE (1) REQUIRED
WEIGHT: 2,250 lbs ± 5%

MATERIAL /CONSTRUCTION/ LABELING INFORMATION:

MATERIAL: CARBON STEEL (ASTM A 36, ASTM A 635 OR ASTM A 569)
MATERIAL THICKNESS: PRIMARY HEADS: 10 GA PRIMARY SHELL: 10 GA (ROARK = 0.1230)

CONSTRUCTION IN ACCORDANCE WITH UNDERWRITERS LABORATORIES UL-58 STANDARD FOR STEEL UNDERGROUND TANKS FOR FLAMMABLE AND COMBUSTIBLE LIQUIDS AND STEEL TANK INSTITUTE STI-P3 SPECIFICATION FOR EXTERNAL CORROSION PROTECTION OF UNDERGROUND STEEL STORAGE TANKS
LABELING/MARKING: UNDERWRITERS LABORATORIES UL-58 / STEEL TANK INSTITUTE STI-P3 / GENERAL INDUSTRIES NAMEPLATE

CUSTOMER:
PROJECT:
AGENTS:

GENERAL INDUSTRIES
BUILDRITE TANKS DIVISION
CORROSION CONTROL PROJECT
P.O. BOX 1279
GOLDSBORO, NC 27533
PHONE: (919)751-1791 FAX: (919)751-8185
DRAWING NUMBER: