


ALL OPENINGS INSTALLED WITH DIELECTRIC BUSHINGS OR SPOOL FLANGES AND FLANGE ISOLATION KITS IN ACCORDANCE WITH STEEL TANK INSTITUTE 1/4" THICK STRIKER PLATES INSTALLED ON THE TANK INTERIOR BOTTOM UNDER EACH OPENING IN ACCORDANCE WITH STEEL TANK INSTITUTE ANODES FOR USE WITH THE STI-P3 CORROSION CONTROL SYSTEM INSTALLED IN ACCORDANCE WITH STEEL TANK INSTITUTE *** THIS TANK DESIGNED FOR BURIAL DEPTH OF 16 FEET (GRADE TO TOP OF TANK) WITH APPROVED BACKFILL MATERIAL ***

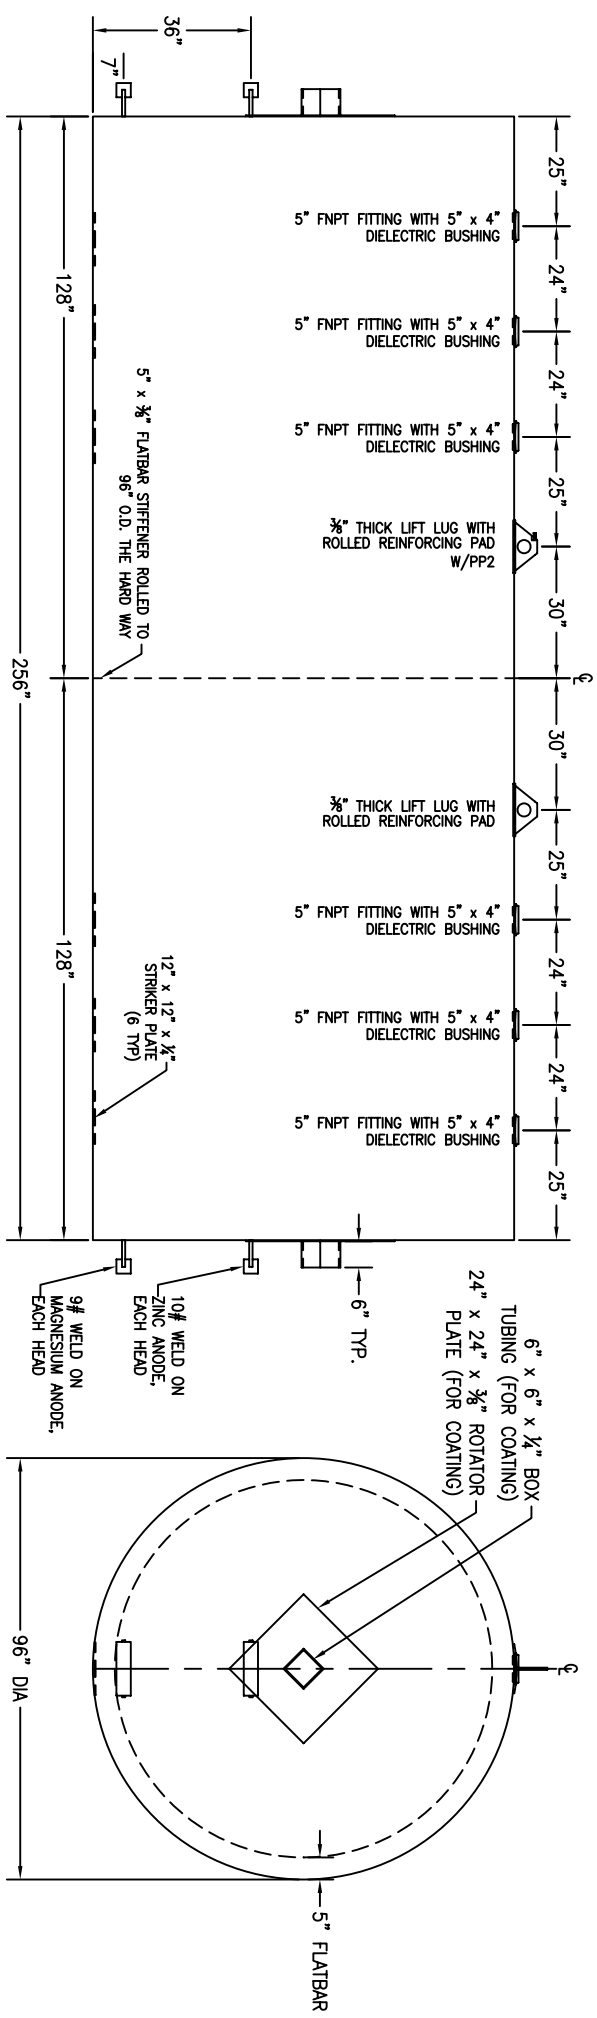

CUSTOMER APPROVAL SIGNATURE/DATE:

8000 GALLON STI-P3 S/W UNDER GROUND TANK

SURFACE PREPARATION/COATING INFORMATION:

INTERIOR SURFACES:
N/A
EXTERIOR SURFACES:
SSPC-SP-6 COMMERCIAL BLAST CLEAN
10-15 mils MINIMUM STI APPROVED POLYURETHANE COATING

MATERIAL /CONSTRUCTION/ LABELING INFORMATION:

MATERIAL: CARBON STEEL (ASTM A 36, ASTM A 635 OR ASTM A 569)
MATERIAL THICKNESS: PRI HEADS: 1/4" PRI SHELL: 7 GA (ROARK = 0.1549 W/STIFFNER)
CONSTRUCTION IN ACCORDANCE WITH UNDERWRITERS LABORATORIES UL-58 STANDARD FOR STEEL UNDERGROUND TANKS FOR FLAMMABLE AND COMBUSTIBLE LIQUIDS AND STEEL TANK INSTITUTE STI-P3 SPECIFICATION FOR EXTERNAL CORROSION PROTECTION OF UNDERGROUND STEEL STORAGE TANKS
LABELING/MARKING: UNDERWRITERS LABORATORIES UL-58 / STEEL TANK INSTITUTE STI-P3 / GENERAL INDUSTRIES NAMEPLATE

QUANTITY: ONE (1) REQUIRED
WEIGHT: 5,750 lbs ± 5%

CUSTOMER: _____
PROJECT: _____
AGENT: _____

GENERAL INDUSTRIES
BUILT FOR TANKS BY THE TANK INSTITUTE
P.O. BOX 1279
ODON, TEXAS 75771
P.O. BOX 1279
GOLDSBORO, NC 27533
PHONE: (919)751-1791 FAX: (919)751-8185
DRAWING NUMBER: _____

