ALL OPENINGS INSTALLED WITH DI-ELECTRIC BUSHINGS OR SPOOL FLANGES AND FLANGE ISOLATION KITS IN ACCORDANCE WITH STEEL TANK INSTITUTE
1/4" THICK STRIKER PLATES INSTALLED ON THE TANK INTERIOR BOTTOM UNDER EACH OPENING IN ACCORDANCE WITH STEEL TANK INSTITUTE
ANODES FOR USE WITH THE STI-P3 CORROSION CONTROL SYSTEM INSTALLED IN ACCORDANCE WITH STEEL TANK INSTITUTE
*** THIS TANK DESIGNED FOR BURIAL DEPTH OF 16 FEET (GRADE TO TOP OF TANK) WITH APPROVED BACKFILL MATERIAL ***

LIFT LUGS OFFSET 30" FROM CENTERLINE

STEEL TANK INSTITUTE STI P3 PRE-ENGINEERED PROVEN PROTECTION

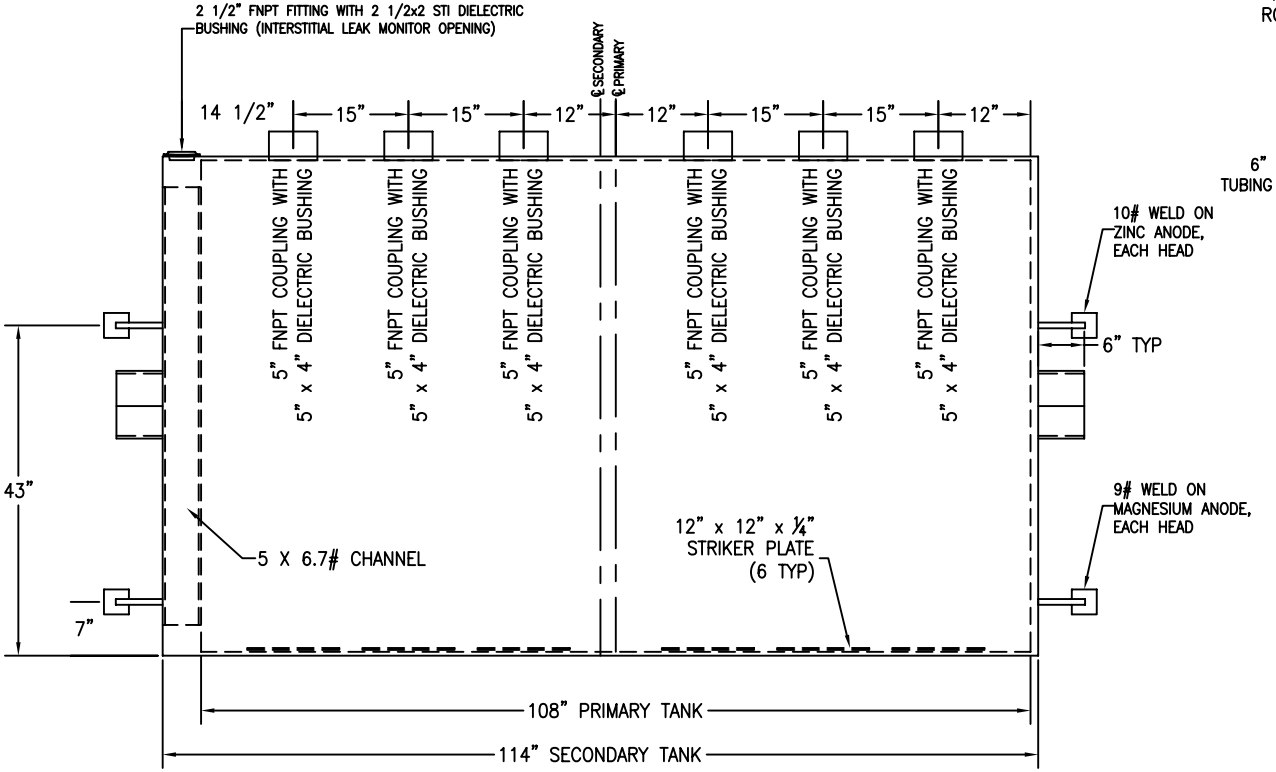

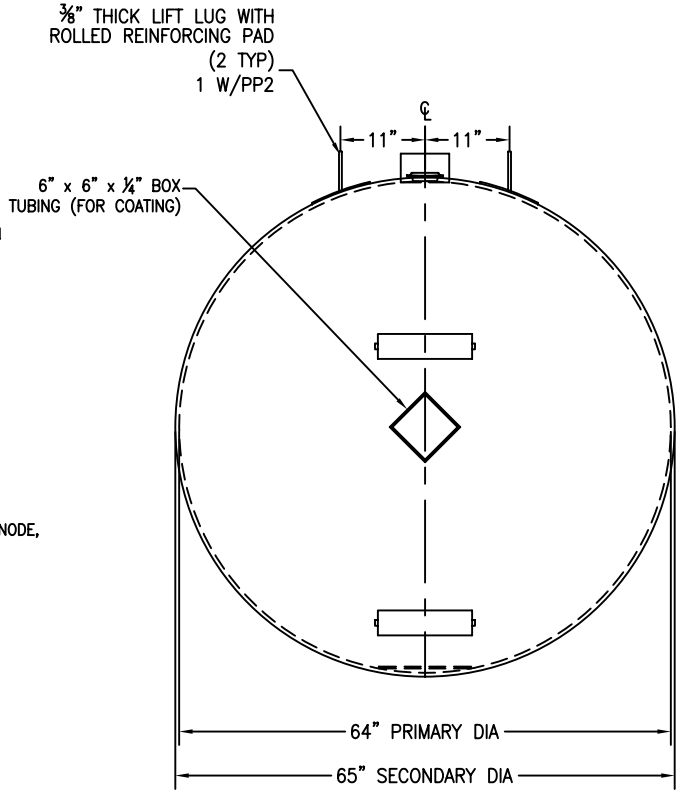

CUSTOMER APPROVAL SIGNATURE/DATE:

QUANTITY: ONE (1) REQUIRED
WEIGHT: 4,250 lbs ± 5%

1,500 GALLON STI-P3 D/W UNDER GROUND TANK

SURFACE PREPARATION/COATING INFORMATION:

INTERIOR SURFACES:
N/A

EXTERIOR SURFACES:
SSPC-SP-6 COMMERCIAL BLAST CLEAN
10-15 mils MINIMUM STI APPROVED POLYURETHANE COATING

MATERIAL /CONSTRUCTION/ LABELING INFORMATION:

MATERIAL: CARBON STEEL (ASTM A 36, ASTM A 635 OR ASTM A 569)

MATERIAL THICKNESS: PRIMARY TANK: 10 GA (ROARK MINIMUM .123) PRIMARY HEADS 10 GA
SECONDARY SHELL: 10 GA SECONDARY HEAD: 7 GA

CONSTRUCTION IN ACCORDANCE WITH UNDERWRITERS LABORATORIES UL-58 STANDARD FOR STEEL UNDERGROUND TANKS FOR FLAMMABLE AND COMBUSTIBLE LIQUIDS AND STEEL TANK INSTITUTE STI-P3 SPECIFICATION FOR EXTERNAL CORROSION PROTECTION OF UNDERGROUND STEEL STORAGE TANKS

LABELING/MARKING: UNDERWRITERS LABORATORIES UL-58 / STEEL TANK INSTITUTE STI-P3 / GENERAL INDUSTRIES NAMEPLATE

CUSTOMER:
PROJECT:
AGENT:

GENERAL INDUSTRIES
BUILDING TANKS TO PROTECT OUR ENVIRONMENT
P.O. BOX 1279 GOLDSBORO, NC 27533
PHONE: (919)751-1791 FAX: (919)751-8186

DRAWING NUMBER: